


ISS.	DATE	COMMENTS
1	04/06/14	ORIGINAL

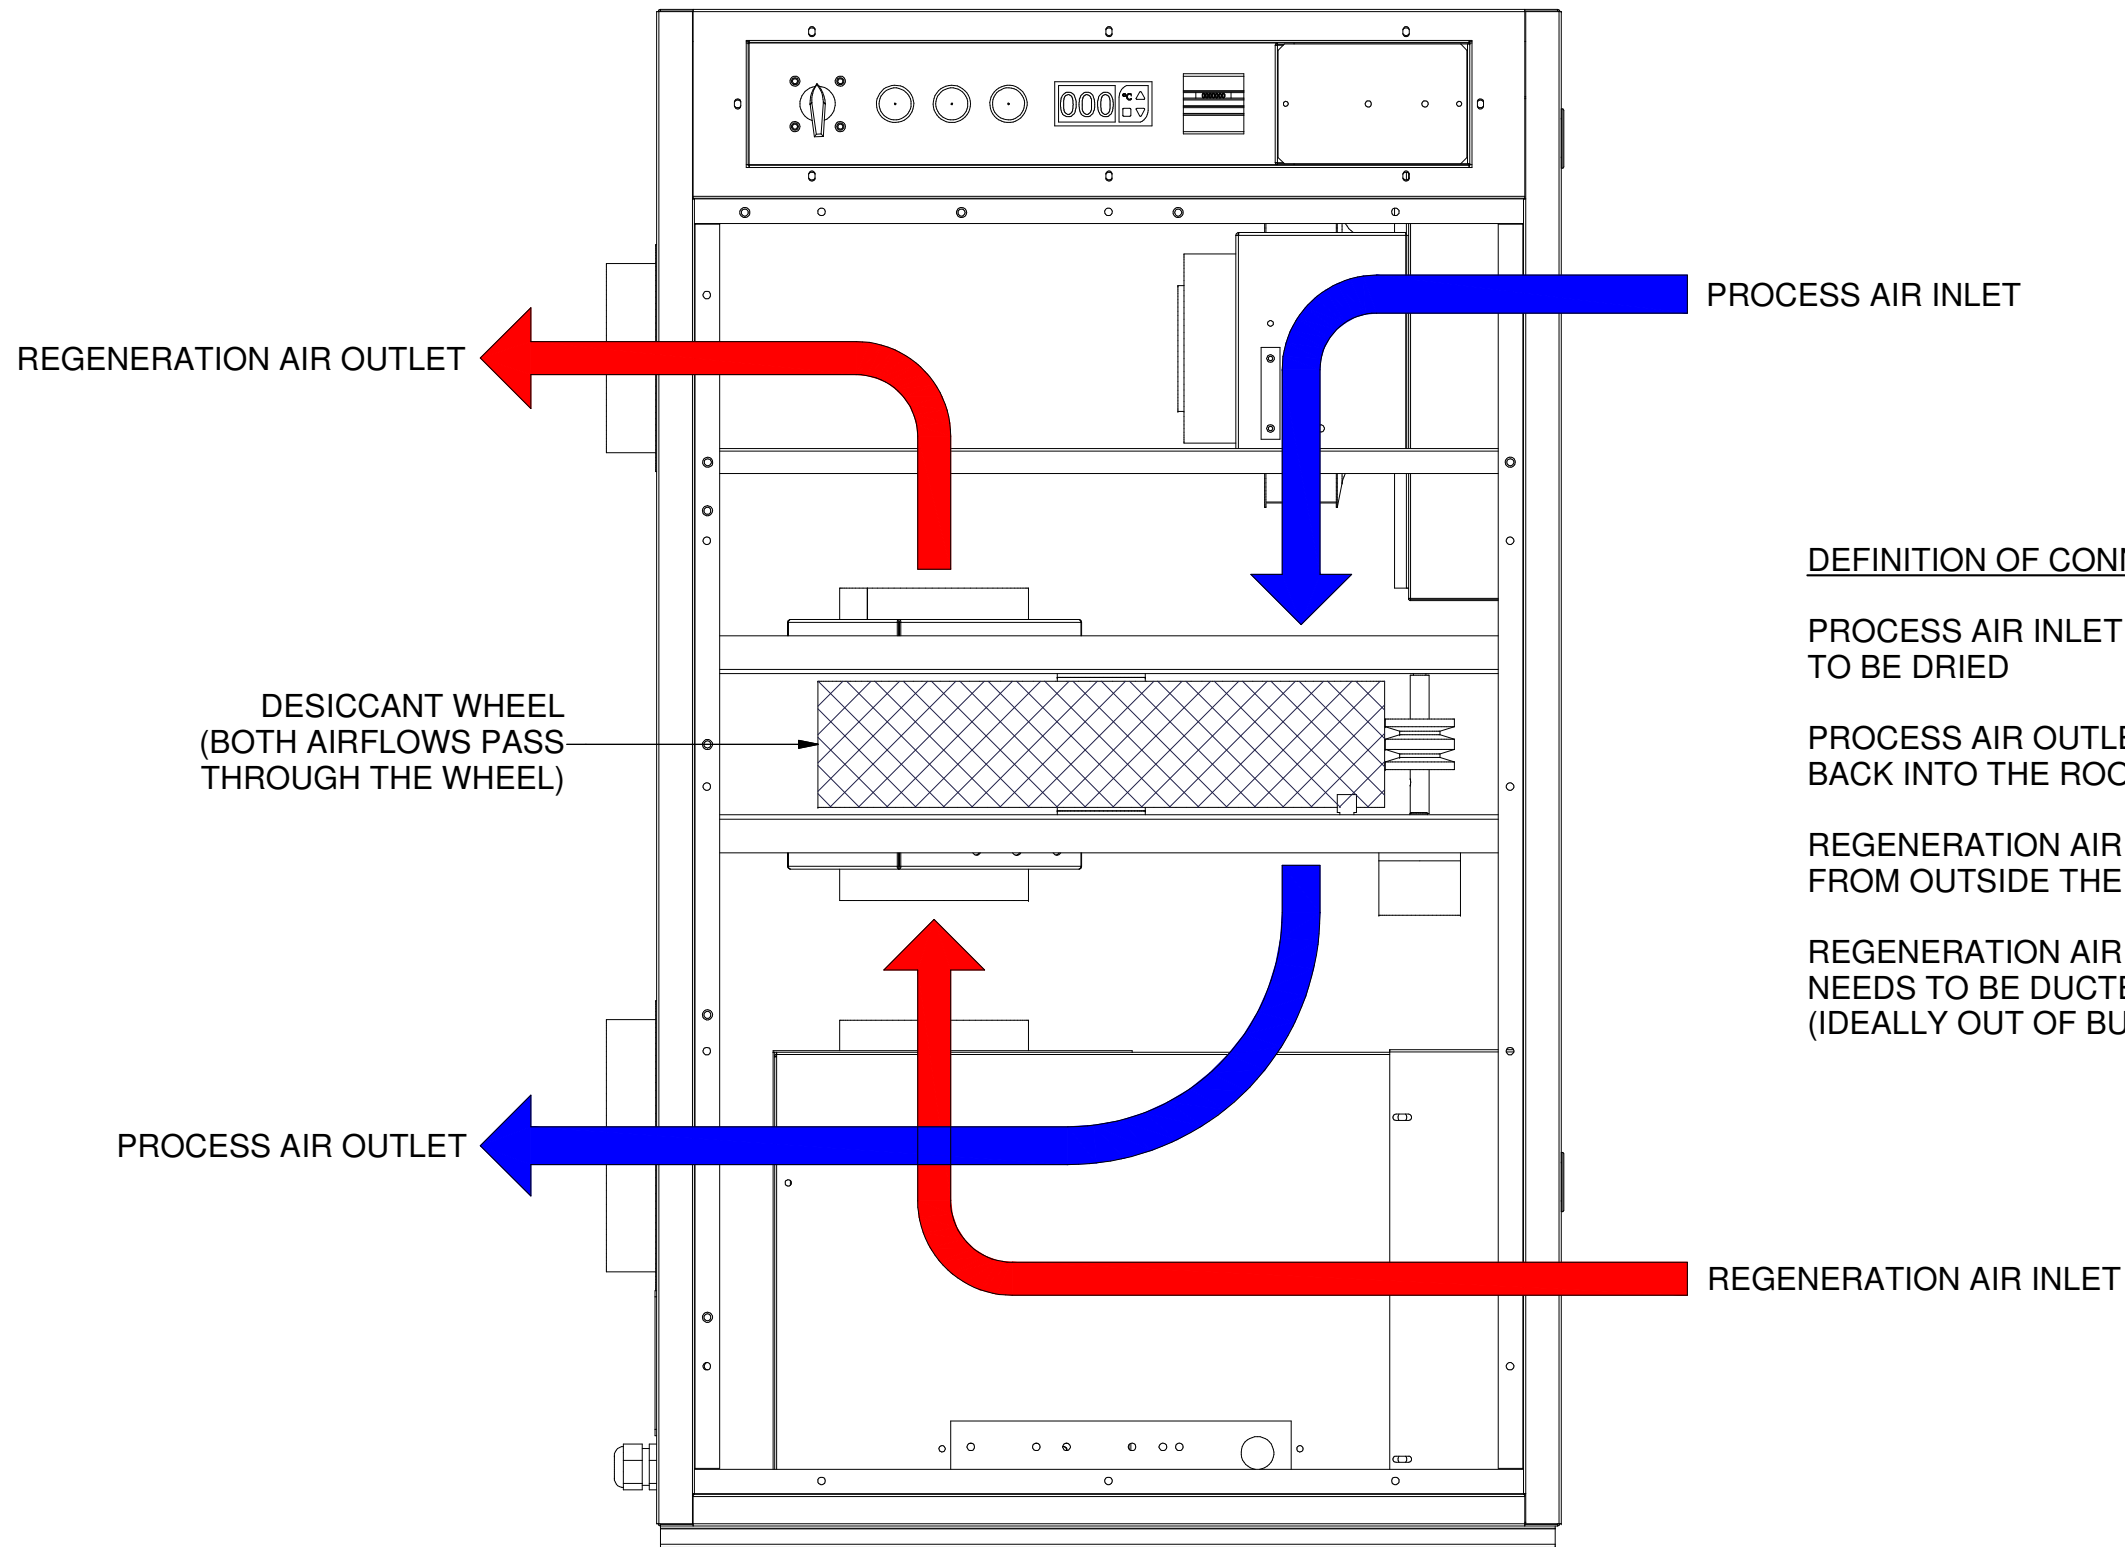



DEFINITION OF CONNECTIONS

PROCESS AIR INLET - THIS IS AIR FROM THE ROOM TO BE DRIED

PROCESS AIR OUTLET - THIS IS DRIED AIR PLACED BACK INTO THE ROOM TO BE DRIED

REGENERATION AIR INLET - THIS SHOULD BE AIR FROM OUTSIDE THE ROOM BEING DRIED

REGENERATION AIR OUTLET - THIS IS WET AIR WHICH NEEDS TO BE DUCTED OUT OF THE ROOM BEING DRIED (IDEALLY OUT OF BUILDING WHERE POSSIBLE)

 BISHOP AUCKLAND Co. DURHAM ENGLAND	TITLE DD MID RANGE - AIRFLOW DIRECTION		
	MATERIAL N/A	DRAWN : W DAGLISH	
3RD ANGLE PROJECTION  DO NOT SCALE IF IN DOUBT ASK	DIMENSIONS IN m.m. TOLERANCES UNLESS OTHERWISE STATED 0. ± 1 0.0 ± 0.25 0.00 ± 0.05 ANGULAR ± 0.5 DEGREE	CAD SCALE : 1/6	
		FINISH N/A	DRG.NO. 1052013